



NOTE:  
SEE APPLICABLE  
NOTES AS SHOWN  
ON 600.

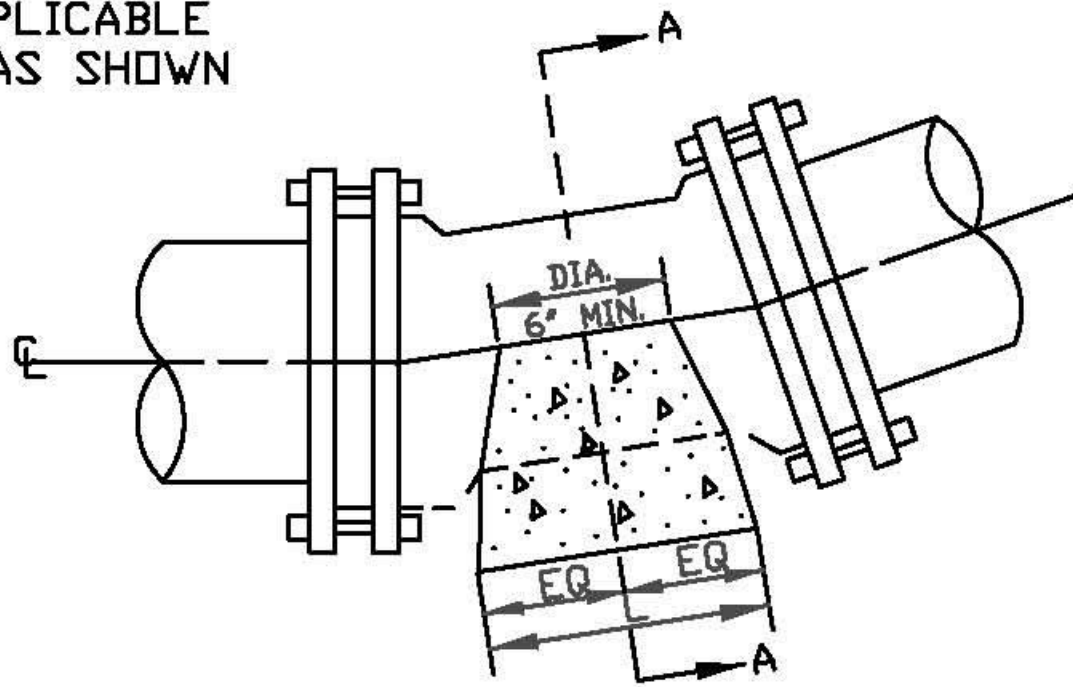

ELEVATION

CARRY CONCRETE TO  
UNDISTURBED EARTH  
OR FIRM SUBGRADE.

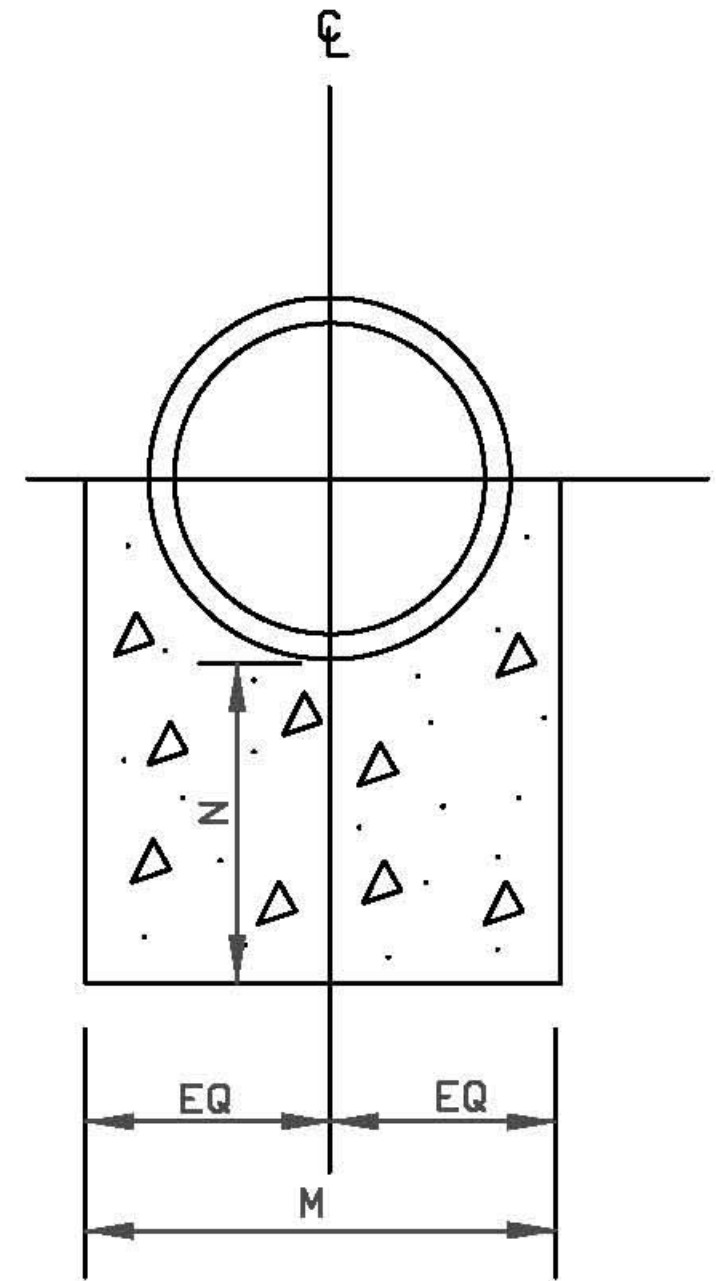

SECTION A-A

PIPE SIZE	11-1/4° BEND			22-1/2° BEND			45° BEND		
	L	M	N	L	M	N	L	M	N
6"	6"	1'-2"	8"	10"	1'-2"	8"	1'-2"	1'-2"	8"
8"	8"	1'-4"	8"	11"	1'-4"	8"	1'-9"	1'-4"	8"
10"	8"	1'-6"	8"	1'-3"	1'-6"	9"	2'-5"	1'-6"	1'-0"
12"	8"	2'-0"	8"	1'-4"	2'-0"	9"	2'-8"	2'-0"	1'-2"
16"	1'-1"	2'-4"	9"	2'-1"	2'-4"	1'-0"	4'-0"	2'-4"	1'-6"
18"	1'-5"	2'-8"	10"	2'-9"	2'-8"	1'-2"	5'-6"	2'-8"	2'-0"
20"	1'-5"	2'-8"	10"	2'-9"	2'-8"	1'-2"	5'-6"	2'-8"	2'-0"
24"	1'-10"	3'-0"	1'-0"	3'-7"	3'-0"	1'-4"	6'-0"	3'-6"	2'-6"

NOTE: BLOCKING BASED ON PRESSURE OF 150 PSI AND ALLOWABLE SOIL BEARING CAPACITY OF 2000 PSF. CONCRETE TO BE 3000 PSI.